


SYMBOL	REVISION REQUIRED	DATE	AUTH.
A	Redrawn	2/04/2008	D.B.O.
B	Centering Circle \emptyset was 8 mm	11/20/2009	D.B.O.

Notes:

1. All dimensions in millimeters.
2. Normal tolerances +/- 0.5 mm
3. SENSITIVITY: 30 minutes/ 2mm
Tolerance on sensitivity is +/- 15 %.

MATERIAL: ACRYLIC
FLUID: CLEAR

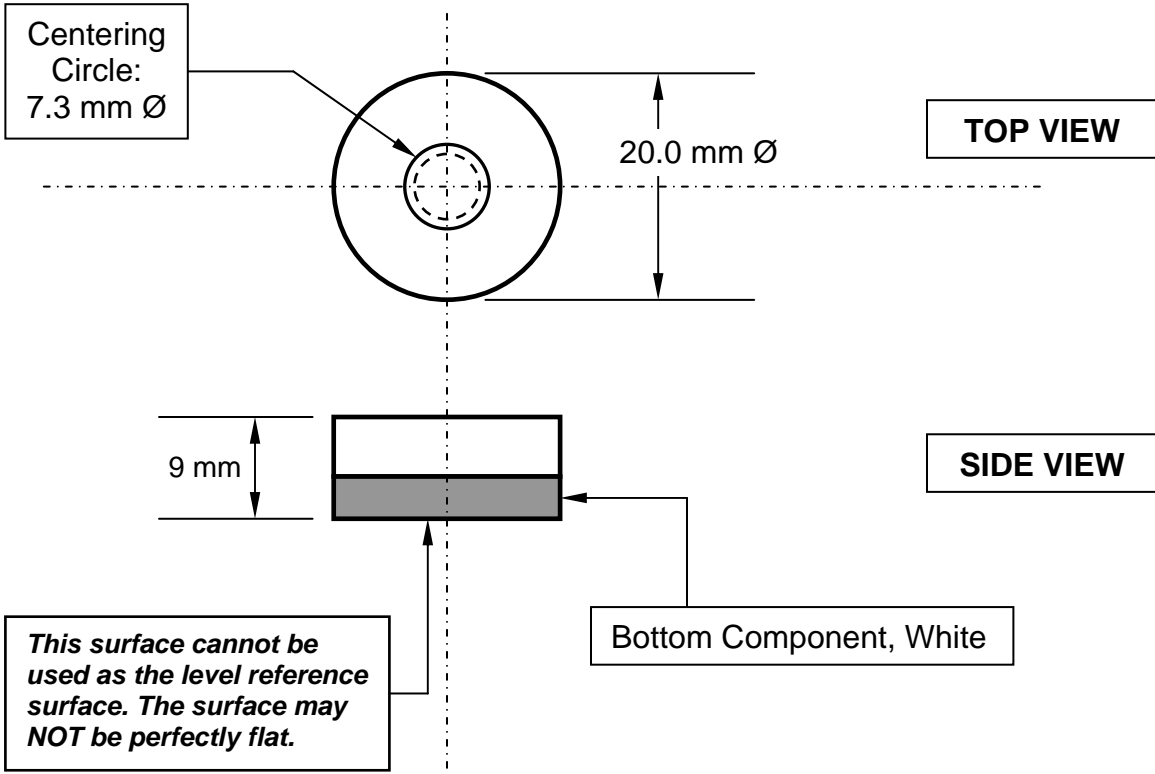

GEIER & BLUHM, INC.
594 River Street
Troy, NY 12180 USA

DRAWN BY: DAVID OSTER

DATE: January 6, 1999

Scale: NONE

DRAWING NUMBER

VIAL, CIRCULAR LEVEL

1-12530