


SYMBOL	REVISION REQUIRED	DATE	AUTH.
A	Redrawn	12/03/2007	D.B.O.
B	Centering Circle $\varnothing$ was 9 mm	11/20/2009	D.B.O.

**Notes:**

1. All dimensions in millimeters.
2. Normal tolerances +/- 0.5 mm
3. SENSITIVITY: 30 minutes/ 2mm  
Tolerance on sensitivity is +/- 15 %.

**MATERIAL: ACRYLIC**  
**FLUID: YELLOW-GREEN**

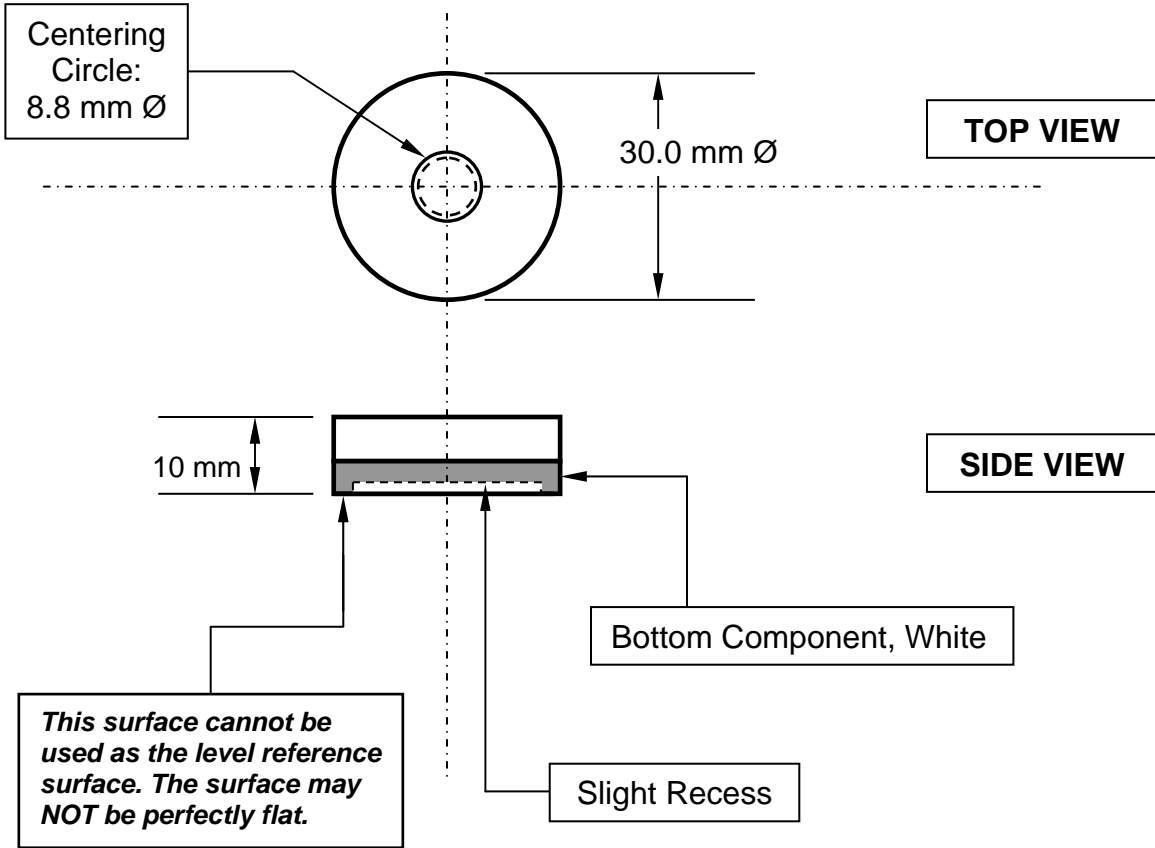

GEIER & BLUHM, INC.  
594 River Street  
Troy, NY 12180 USA

DRAWN BY: DAVID OSTER

DATE: March 24, 2006

Scale: NONE

DRAWING NUMBER

VIAL, CIRCULAR LEVEL

**1-18537**