

SYMBOL	REVISION REQUIRED	DATE	AUTH.


Notes:

1. All dimensions are in inches.
2. SENSITIVITY: 60 minutes/ 0.1" movement of the bubble. Tolerance on sensitivity is $\pm 15\%$.
3. Part or all of the finish maybe removed from Surface "X" during calibration.

MATERIAL: Housing: Brass
Vial: Glass

FLUID: Clear Mineral Spirits

FINISH on Housing: Chrome-Plate

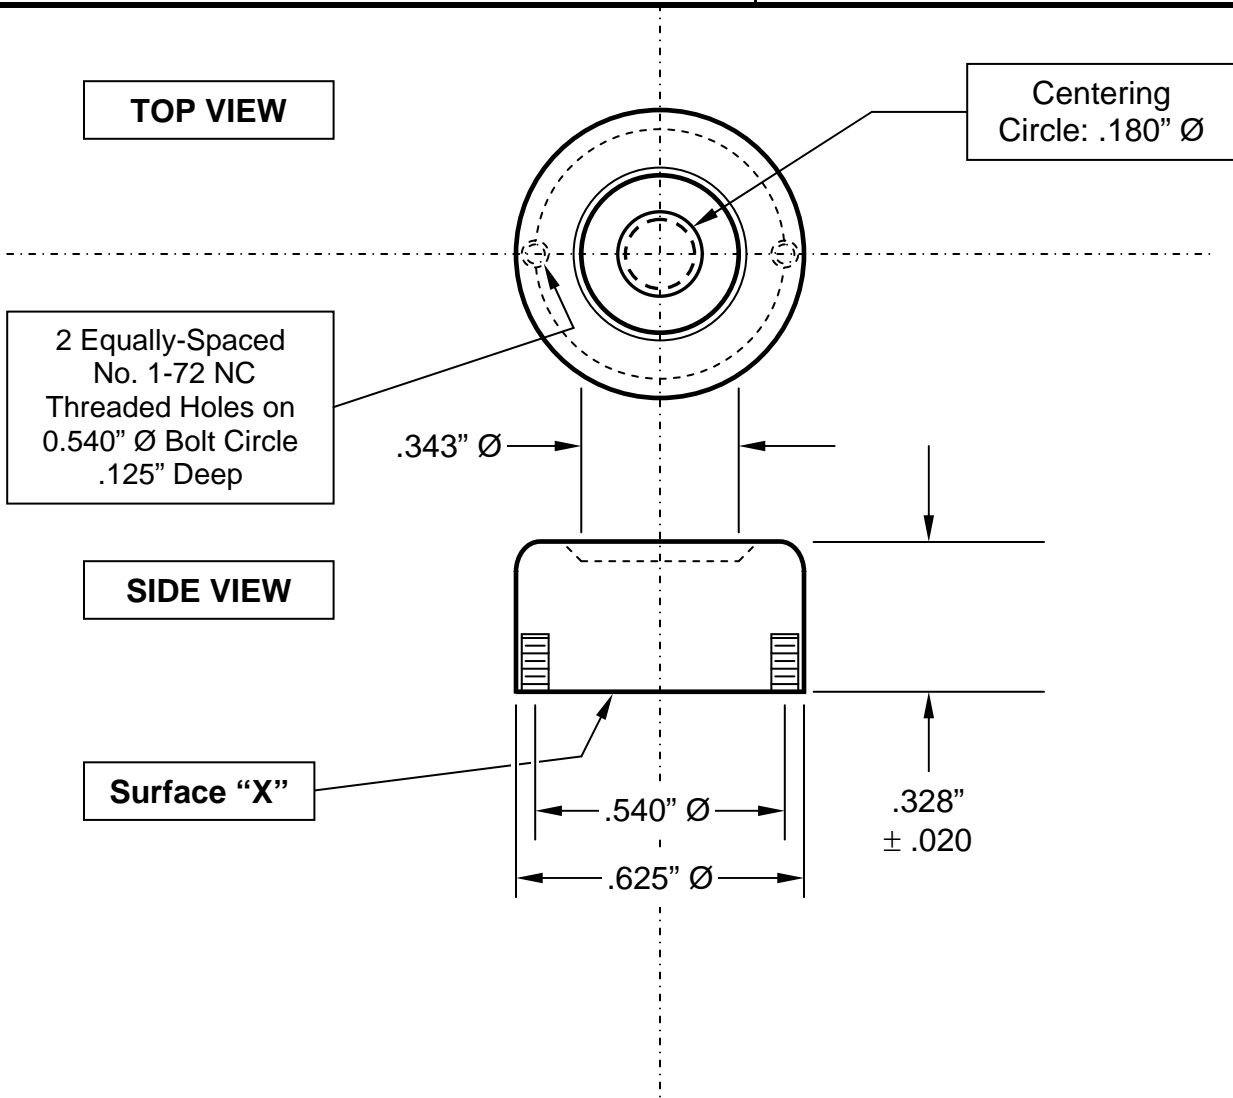

Tolerances: (except as noted) **Decimal $\pm .010$ "** **Fractional $\pm 1/64$ "** **Angular $\pm 1^\circ$**

GEIER & BLUHM, INC. Division of HJM Precision, Inc. 594 River Street Troy, NY 12180 USA	DRAWN BY: DAVID OSTER	DATE: November 22, 2011
	Scale: NONE	DRAWING NUMBER
	MOUNTED CIRCULAR LEVEL	2-04009