


SYMBOL	REVISION REQUIRED	DATE	AUTH.

Notes:

1. All dimensions in inches.
2. SENSITIVITY: 60 minutes / .1" movement of the bubble
Tolerance on sensitivity is $\pm 10\%$.
3. Part or all of the finish maybe removed from Surface "X" during calibration.
4. Bubble is sized just inside centering circle at 70° F to 75° F

MATERIAL: Housing: Brass
Vial: Glass
FINISH on Housing: Black Lacquer Paint
FLUID: Mineral Spirits
COLOR of FLUID: Clear

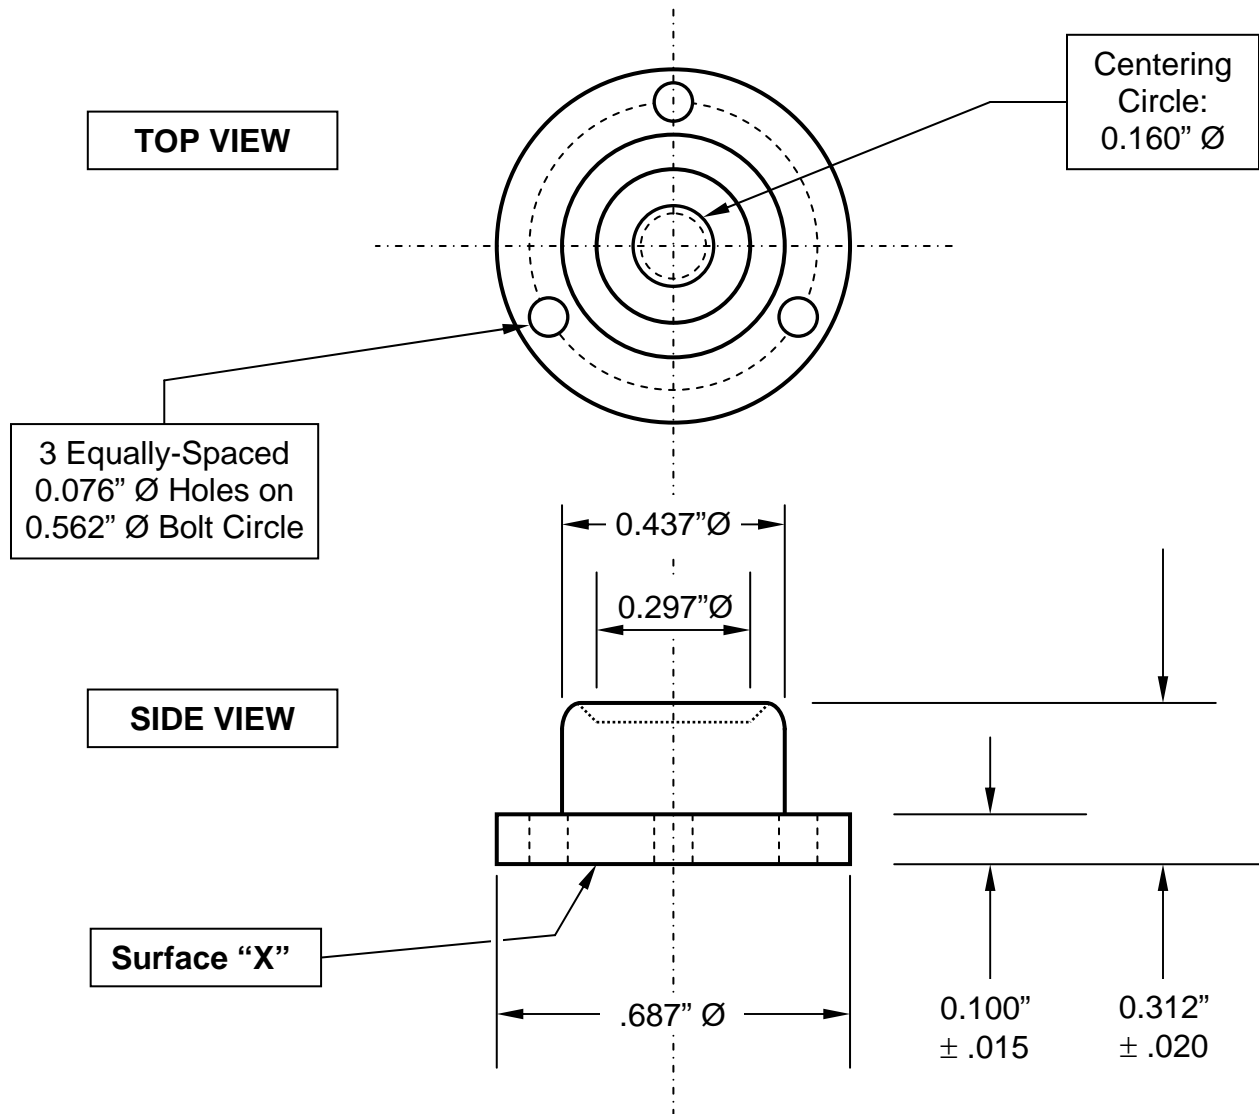

GEIER & BLUHM, INC. 594 River Street Troy, NY 12180 USA	Tolerances: (except as noted)	Decimal $\pm .010''$	Fractional $\pm 1/64''$	Angular $\pm 1^\circ$
	DRAWN BY: DAVID OSTER		DATE: August 5, 2009	
	Scale: NONE MOUNTED CIRCULAR LEVEL		DRAWING NUMBER 2-05059	