


SYMBOL	REVISION REQUIRED	DATE	AUTH.

Notes:

1. Normal tolerances +/- 0.5 mm
2. SENSITIVITY: 30 minutes/ 2mm
Tolerance on sensitivity is +/- 10 Minutes.

MATERIAL: ACRYLIC
FLUID: GREEN-YELLOW

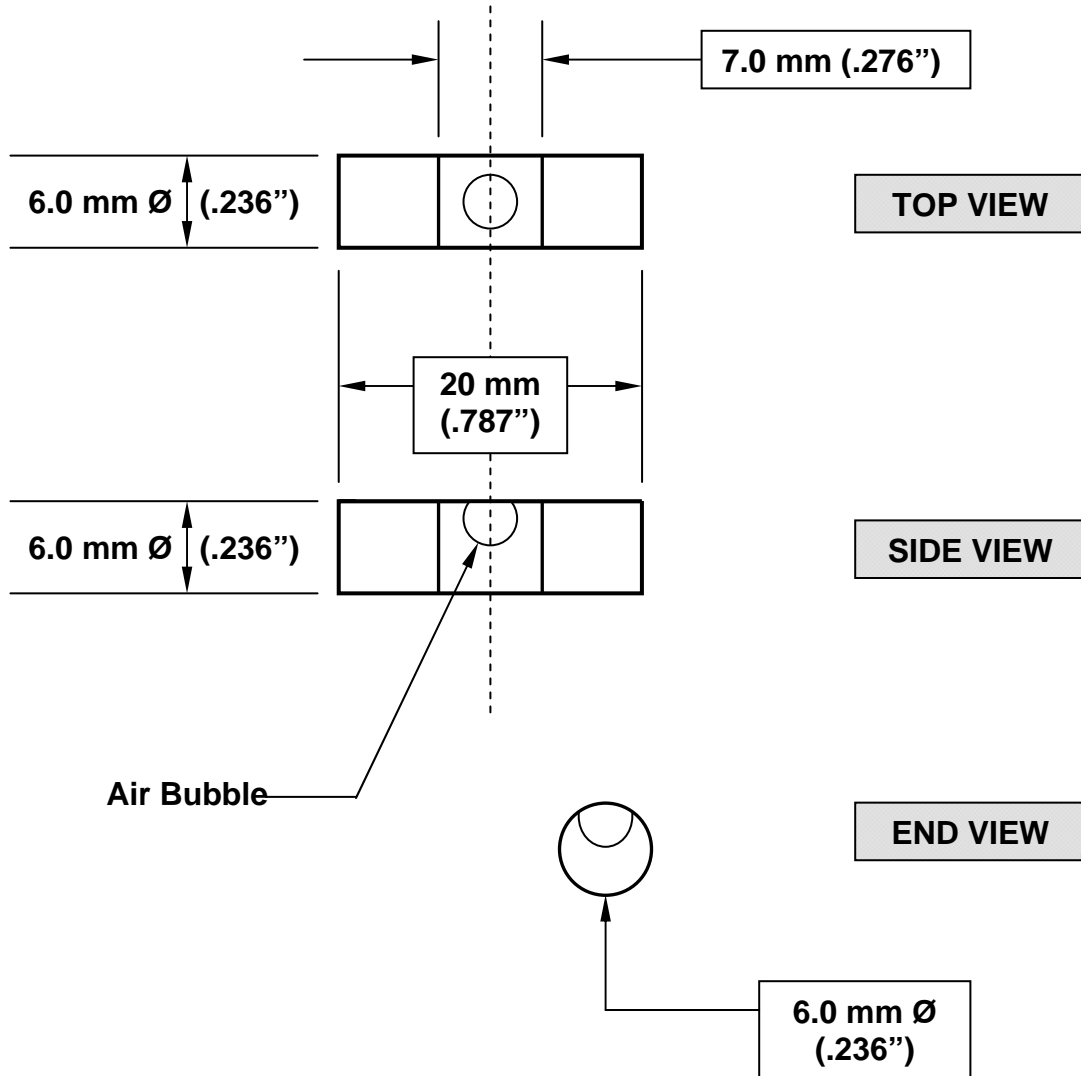

GEIER & BLUHM, INC.
594 River Street
Troy, NY 12180 USA

DRAWN BY: DAVID OSTER

DATE: May 7, 2009

Scale: NONE

DRAWING NUMBER

TUBULAR LEVEL VIAL

3-0505